

NOTE:

- ROOM HEIGHT 3.5M MINIMUM CLEAR
- DOOR HEIGHT 3.0M MINIMUM FEL.
- 2X2.2 m CEMENT CLAUSTRA FOR VENTILATION
- D1=3X2.7 m HOT DEEPEED GALVANISED STEEL GRILL TYPE DOOR
- D2=3X2.5 m ALUMINUM SOLID PANAL DOOR
- D3=3X1.2 m ALUMINUM SOLID PANAL DOOR
- ALL TRENCHES 80 cm DEEP MINIMUM
- TRENCH COVER GALVANIZED IRON GRATING 5cm THICK
- SLOT IN ROOF 25 cm WIDE AS SHOWN AND TO BE COMPLETELY OPEN UP TO THE SLAB EDGE AND THROUGH THE FACADR
- F.F.L OF SUB-STATION TO BE 35cm ABOVE WALK WAY
- ALL DIMENSIONS ARE IN M. UNLESS OTHERWISE NOTED


** ACCEPTED min. SIZE
(4.8 x 10 x 3.5) m for transformer room.
(4.9 x 7.4 x 3.5) m for H.V room.



شركة العين للتوزيع
Al Ain Distribution Company

SHEET TITLE:

Electrical Substation Room With Three Transformers & H.V Panel

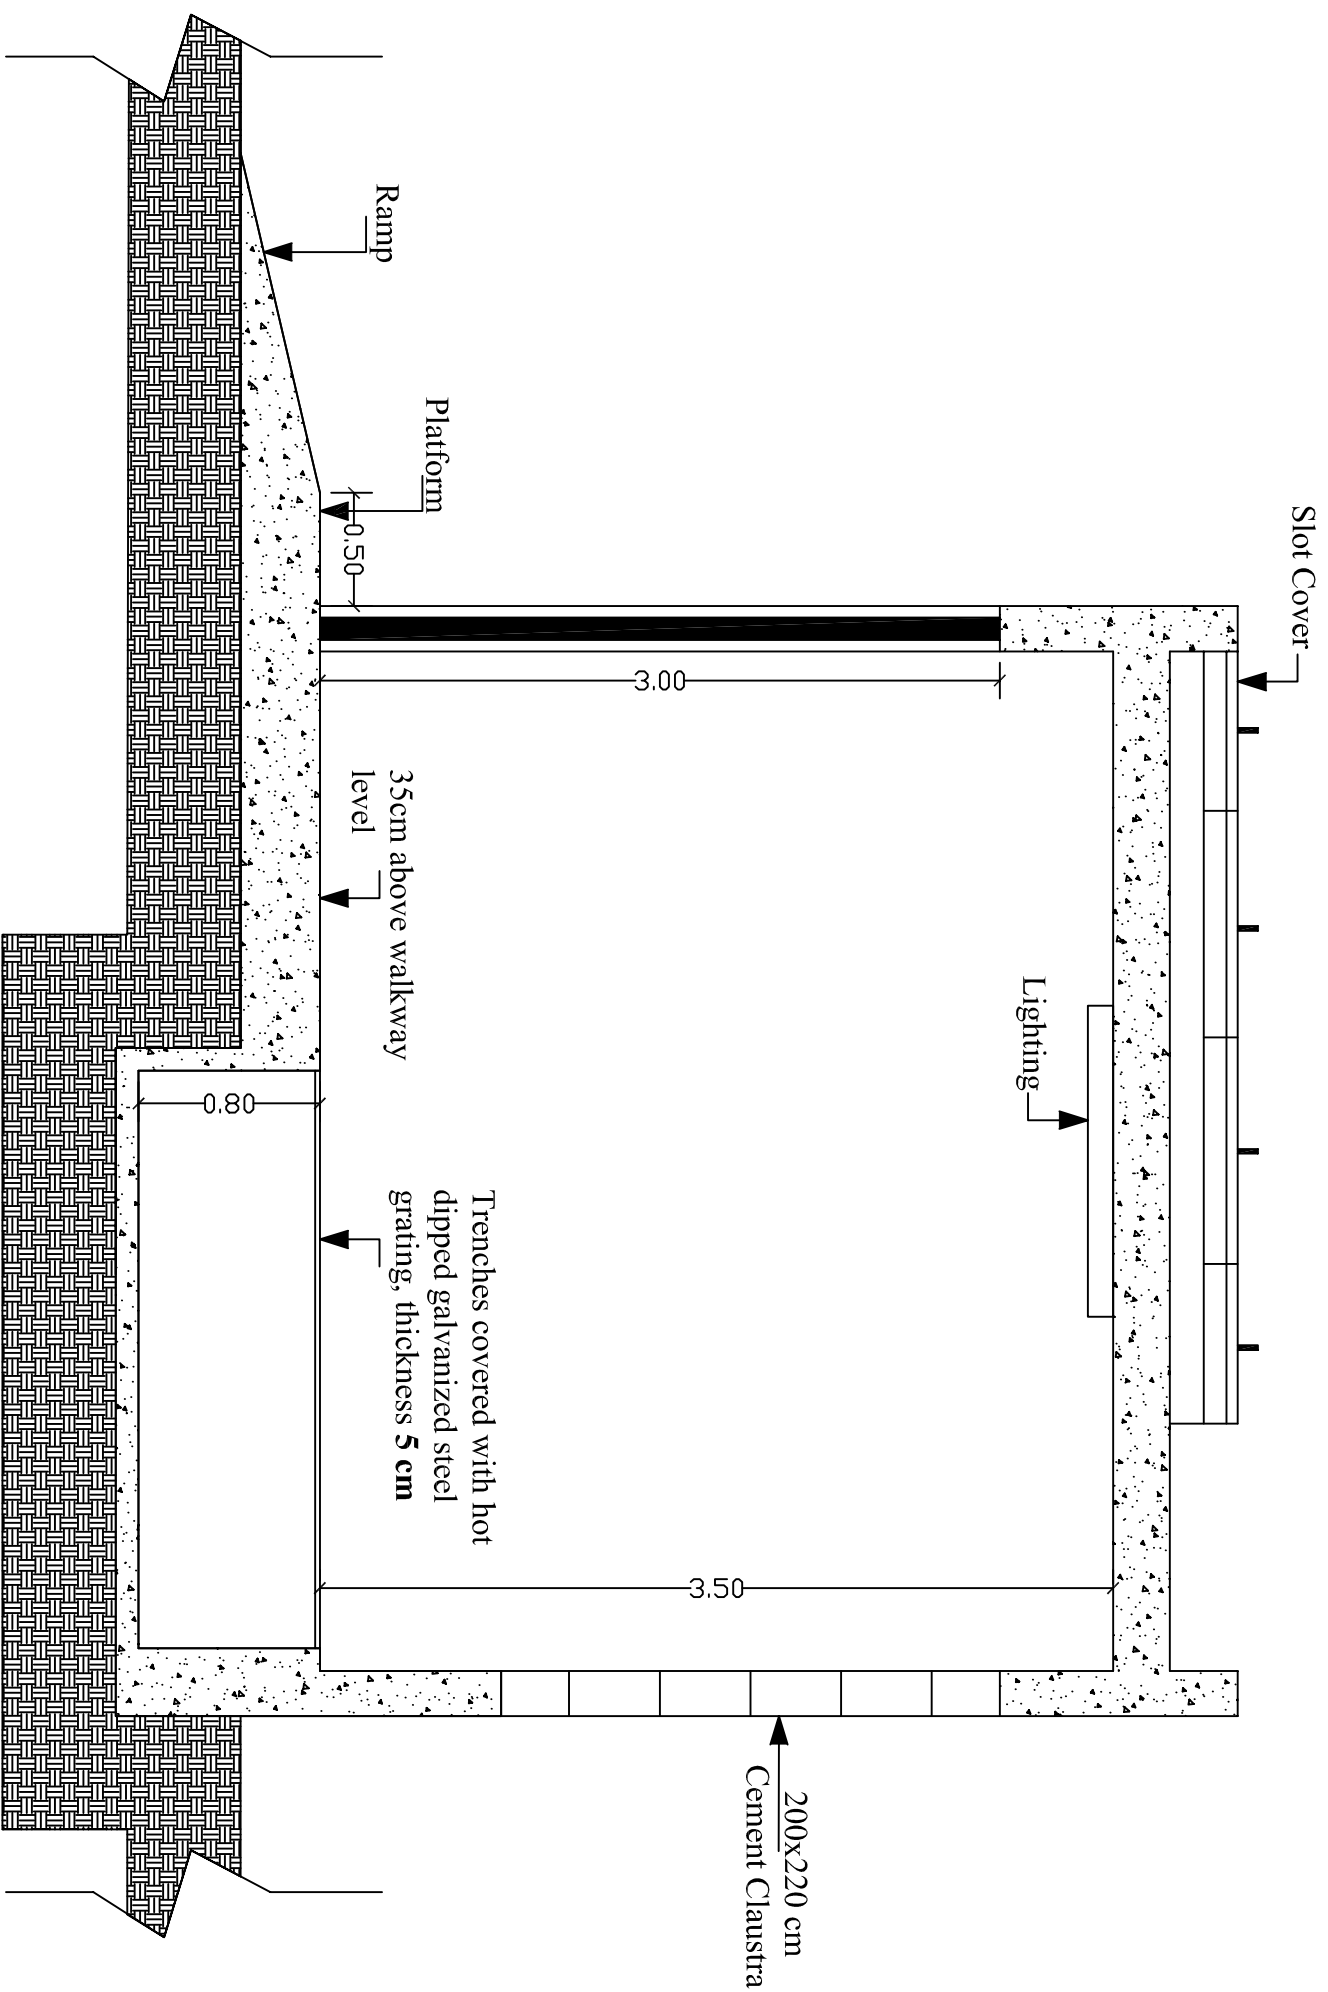

Section

NOTE :

- ROOM HEIGHT 3.5M MINIMUM CLEAR
- DOOR HEIGHT 3.0M MINIMUM FEL.
- 2X2.2 m CEMENT CLAUSTRA FOR VENTILATION
- D1=3X2.7 m HOT DEEPEED GALVANISED STEEL GRILL TYPE DOOR
- D2=3X2.5cm ALUMINUM LOUVERED DOOR
- ALL TRENCHES 80 cm DEEP MINIMUM
- TRENCH COVER GALVANIZED IRON GRATING 5cm THICK
- SLOT IN ROOF 25 cm WIDE AS SHOWN AND TO BE COMPLETELY OPEN UP TO THE SLAB EDGE AND THROUGH THE FACADR
- F.F.L OF SUB-STATION TO BE 35cm ABOVE WALK WAY

-ALL DIMENSIONS ARE IN M. UNLESS OTHERWISE NOTED

**** ACCEPTED min. SIZE**

- (4.8 x 10 x 3.5) m for transformer room.
- (4.9 x 7.4 x 3.5) m for H.V room.



شركة العين للتوزيع
Al Ain Distribution Company

SHEET TITLE:

Electrical Substation Room With Three Transformers & H.V Panel